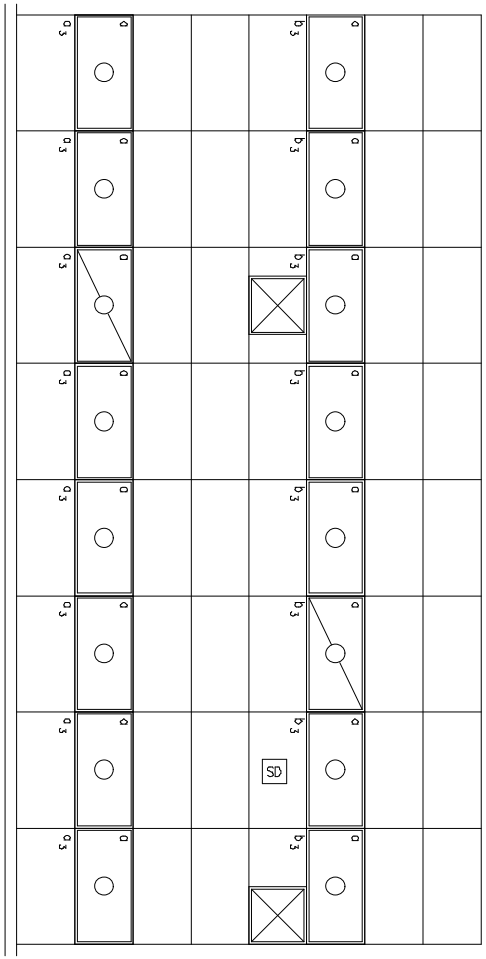

NOTES:

1. Use duplex receptacle computer isolation, on separate circuit when service not located in rail at all computer stations.
2. 2' x 4' (610mm x 1219mm) recessed flour. w/4 – F40 CW lamps
3. 2' x 2' (610mm x 610mm) recessed flour. w/2 – F20 CW lamps
4. 2' x 4' (610mm x 1219mm) recessed flour. w/3 – F40 CW lamps
5. 2' x 4' (610mm x 1219mm) recessed flour. w/2 – F40 CW lamps
6. Motorized Ceiling HEPA Filters, Class 10, 47 5/8" x 23 5/8" (1219mm x 609mm)

LEGEND

- Light Fixture Emergency On Power. Clinic Requires Battery Ballast
- a_1 (a) — Fixture Type a_1 (see note 2) Control Switch a
- a_1 (a_3) — Fixture Type a_1 (see note 2) Control Switch a_3
- b_1 (a) — Fixture Type b_1 (see note 5) Control Switch a
- c_1 (a) — Fixture Type c_1 (see note 4) Control Switch a
- c_1 (a_4) — Fixture Type a_1 Control Switch a_4
- Ceiling HEPA Filter (see note 6)
- a_2 (a_3) — Fixture Type a_2 (see note 3) Control Switch a_3
- Ceiling Air Diffuser
- Ceiling Air Return
- S_a — Switch Fixture a
- S_{a_3} — Switch Fixture a_3
- S_{a_4} — Switch Fixture a_4
- SD — Ionization Smoke Detectors

MEDIUM LAB HEMATOLOGY (LMHI3)

MILCARE

CEILING PLAN — 38.66 NSM (416 NSF) MIN.

DATE: 11/26/2002

0 1000 2000

1:50 SCALE (MILLIMETERS)