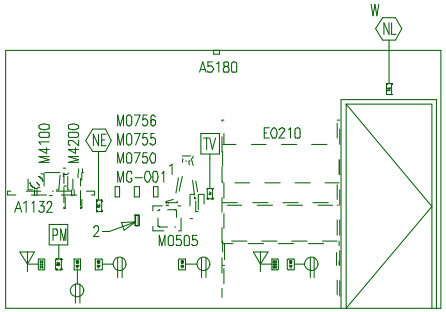

NORTH

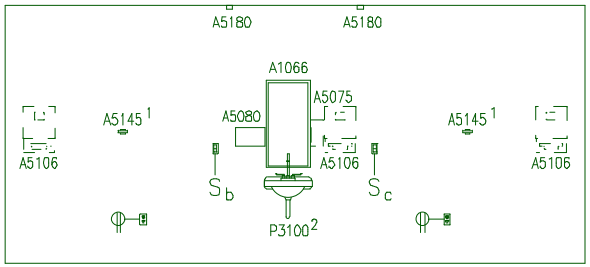

WEST

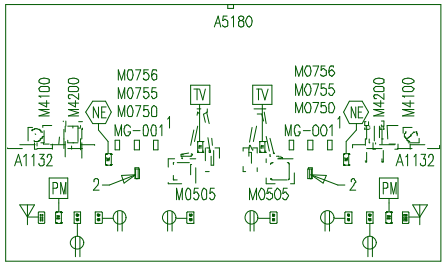

SOUTH



WEST (TOILET)



NORTH (TOILET)

General Notes:

1. For typical equipment mounting heights see "TYPICAL EQUIPMENT MOUNTING HEIGHTS" drawing.
2. MIL-STD-1691 data can only be accessed from the Equipment Plan.

KEY NOTES
1. PROVIDE BOTTLED GAS IF BUILDING PIPED MCA AND OX ARE NOT AVAILABLE.
2. VACUUM SLIDE.
3. MOUNT A5145, HOOK, AT 1372 [4'-6"] AFF. PROVIDE 2-A5145'S FOR NAVY PROJECTS ONLY. MOUNT 1-A5145 AT 1372 [4'-6"] AFF AND 1-A5145 AT 1524 [5'-0"] AFF.
4. P3200, UITR ELECTRONIC LAVATORY, MAY BE USED INSTEAD OF P3100, LAVATORY. FOR THE P3200 PROVIDE EITHER BATTERY POWER OR HARD WIRED CONNECTION.
5. PROVIDE A5109, GRAB BAR, THAT COMPLIES WITH ADA.

OUTPATIENT NON-STRESS TESTING & TOILET, UNISEX (OPST1/TLTU1)

WOMEN'S HEALTH	
ELEVATIONS	31.96 NSM (344 NSF)
DATE: 07/12/2001	

0 1000 2000

1:50 SCALE (MILLIMETERS)