


WEST

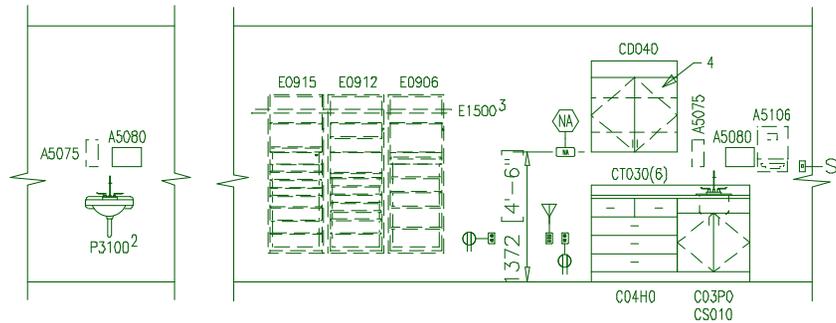

NORTH


EAST

KEY NOTES

1. PROVIDE A1165, IV TRACKS, FOR NAVY PROJECTS ONLY.
2. PROVIDE AT LEAST ONE HANDWASHING FACILITY OR ONE FOR EVERY THIRD RECOVERY MODULE. P3200, UTR ELECTRONIC LAVATORY, MAY BE USED INSTEAD OF P3100, LAVATORY. FOR THE P3200 PROVIDE EITHER BATTERY POWER OR HARD WIRED CONNECTION.
3. LENGTH OF E1500, WALL MOUNTED RAIL, TO BE DETERMINED BY MANUFACTURER/INSTALLER.
4. ALL CABINETS SHALL BE LOCKING.

General Notes:

1. For typical equipment mounting heights see "TYPICAL EQUIPMENT MOUNTING HEIGHTS" drawing.
2. MIL-STD-1691 data can only be accessed from the Equipment Plan.

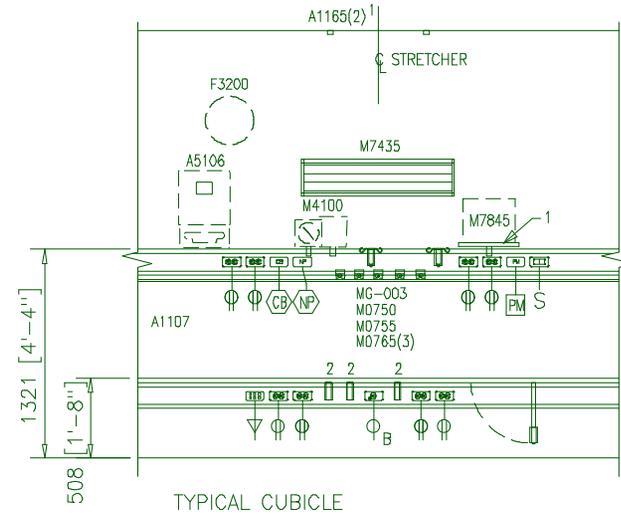

TYPICAL CUBICLE

NOTES

1. THE UTILITIES AND DEVICES INDICATED ARE FOR AN EMERGENCY ROOM IN A HOSPITAL.
2. ALL RECEPTACLES IN HEADWALL SHALL BE HOSPITAL GRADE.

KEY NOTES

1. PROVIDE A1165, IV TRACKS, FOR NAVY PROJECTS ONLY.
2. VACUUM SLIDE.

RECOVERY CUBICLE, OUTPATIENT & NURSE STATION, OUTPATIENT CLINICS (RROP1/NSTA4)

SURGERY (INPATIENT & AMBULATORY)

ELEVATIONS

52.68 NSM (567)

DATE: 07/12/2001

0 1000 2000



1:50 SCALE (MILLIMETERS)