

TYPICAL CUBICLE

NOTES

1. THE UTILITIES AND DEVICES INDICATED ARE FOR AN EMERGENCY ROOM IN A HOSPITAL.
2. ALL RECEPTACLES IN HEADWALL SHALL BE HOSPITAL GRADE.


KEY NOTES

1. PROVIDE A1165, IV TRACKS FOR NAVY PROJECTS ONLY.
2. MONITOR SHELF.
3. SWITCH CONTROLS CEILING MOUNTED FLUORESCENT LIGHT FIXTURES.
4. TONE/VISUAL OR AUDIO/VISUAL PATIENT STATION AS REQUIRED BY THE USING MILITARY DEPARTMENT.
5. CODE BLUE AS REQUIRED BY USING MILITARY DEPARTMENT.
6. VACUUM SLIDE.
7. TWO MOMENTARY CONTACT TOGGLE SWITCHES FOR CONTROL OF UP AND DOWN LIGHT SECTIONS OF FIXTURE M7435.

0 500 1000



1:30 SCALE (MILLIMETERS)

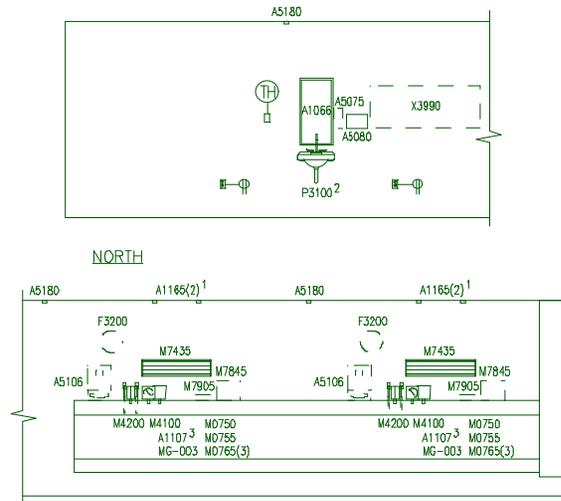


NORTH

WEST

KEY NOTES

1. PROVIDE A1165, IV TRACKS, FOR NAVY PROJECTS ONLY.
2. PROVIDE AT LEAST ONE HANDWASHING FACILITY OR ONE FOR EVERY THIRD RECOVERY MODULE. P3200, ELECTRONIC LAVATORY, MAY BE USED INSTEAD OF P3100, LAVATORY. FOR THE P3200 PROVIDE EITHER BATTERY POWER OR HARD WIRED CONNECTION.
3. SEE ELEVATION OF A1107, UTILITY RAIL SYSTEM, FOR UTILITIES.

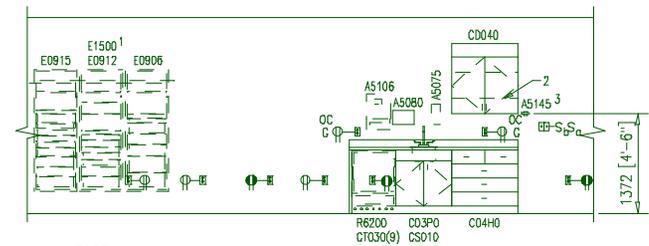

EAST

KEY NOTES

1. LENGTH OF E1500, WALL MOUNTED RAIL, TO BE DETERMINED BY MANUFACTURER/INSTALLER.
2. ALL CABINETS SHALL BE LOCKING.
3. MOUNT A5145, HOOK, AT 1372 [4'-6"] AFF.

General Notes:

1. For typical equipment mounting heights see "TYPICAL EQUIPMENT MOUNTING HEIGHTS" drawing.
2. MIL-STD-1691 data can only be accessed from the Equipment Plan.

RECOVERY ROOM, INPATIENT
& NURSE STATION, SUBSTATION (RRSS1/NSTA3)

SURGERY (INPATIENT & AMBULATORY)

ELEVATIONS 57.74 NSM (621 NSF)

DATE: 01/28/2002

0 1000 2000



1:50 SCALE (MILLIMETERS)