

NOTES



1. SEE TYPICAL EQUIPMENT MOUNTING HEIGHTS BEGINNING ON SHEET 7.01.01.
2. PROVIDE HOSPITAL GRADE RECEPTACLES AT PATIENT STRETCHER ON EMERGENCY POWER WHEN INSTALLED IN A HOSPITAL.

KEY NOTES

1. ALL CABINETS SHALL BE LOCKING.
2. PROVIDE BOTTLED GAS IF BUILDING PIPED MCA AND OX ARE NOT AVAILABLE.
3. PROVIDE A1165, IV TRACKS, FOR NAVY PROJECTS ONLY.
4. VACUUM SLIDE.

General Notes:

1. For typical equipment mounting heights see "TYPICAL EQUIPMENT MOUNTING HEIGHTS" drawing.
2. MIL-STD-1691 data can only be accessed from the Equipment Plan.

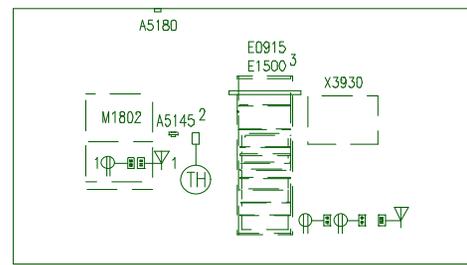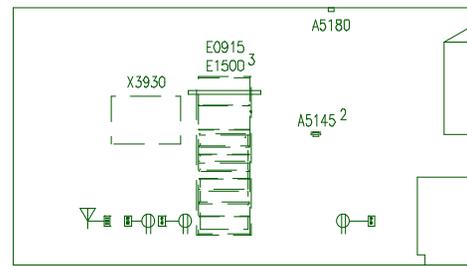

KEY NOTES

1. COORDINATE LOCATION OF ELECTRICAL OUTLETS WITH M1802, WALL MOUNTED, FOLD DOWN COMPUTER.
2. MOUNT A5145, HOOK, AT 1372 [4'-6\"] AFF. PROVIDE 2-A5145'S FOR NAVY PROJECTS ONLY.
 MOUNT 1-A5145 AT 1372 [4'-6\"] AFF AND 1-A5145 AT 1524 [5'-0\"] AFF.
3. LENGTH OF E1500, WALL MOUNTED RAIL, TO BE DETERMINED BY MANUFACTURER/INSTALLER.

TREATMENT ROOM,
 GENERAL, 2 BED (TRGM2)

PRIMARY CARE/FAMILY PRACTICE

ELEVATIONS 31.84 NSM (343 NSF)

DATE: 07/12/2001

