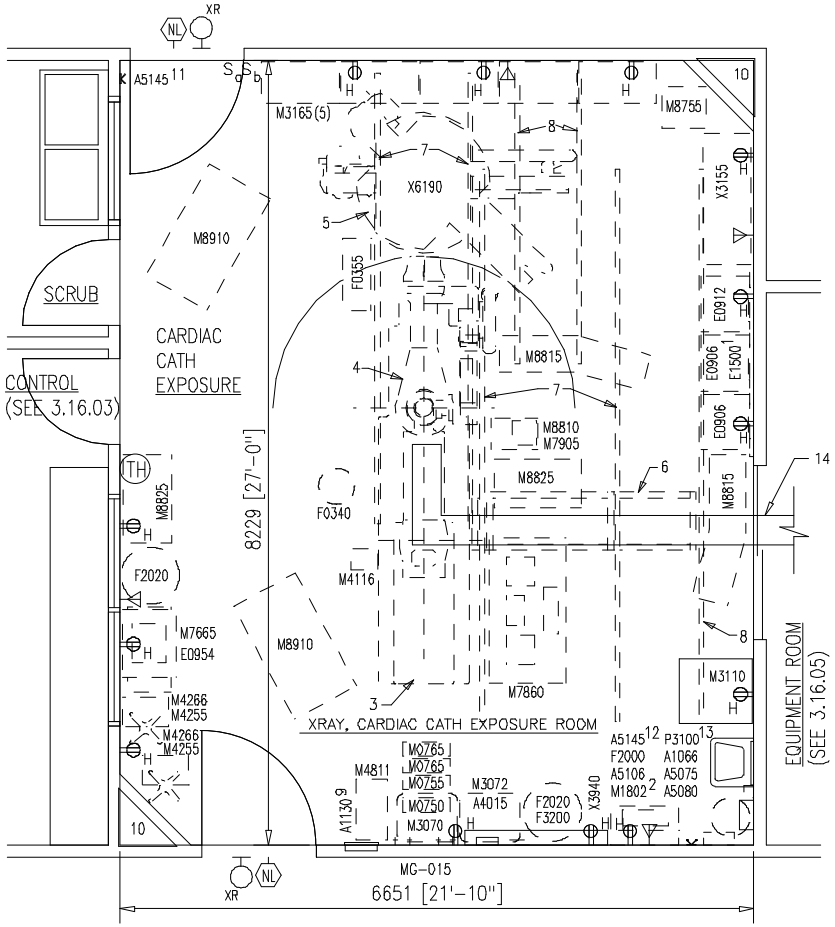

NOTES
1. RECEPTACLES ON CRITICAL POWER SHALL BE SERVED FROM TWO DIFFERENT CRITICAL BRANCH TRANSFER SWITCHES.

KEY NOTES
1. LENGTH OF E1500, WALL MOUNTED RAIL, TO BE DETERMINED BY MANUFACTURER/INSTALLER.
2. COORDINATE LOCATION OF ELECTRICAL OUTLETS WITH M1802, WALL MOUNTED, FOLD DOWN COMPUTER.
3. TABLE FOR X6190, RAD/FLUORO UNIT.
4. POSITIONER FOR X6190, RAD/FLUORO UNIT.
5. LATERAL POSITIONER FOR X6190, RAD/FLUORO UNIT.
6. MONITORS AND SUPPORT FOR X6190, RAD/FLUORO UNIT.
7. STATIONARY RAIL FOR X6190, RAD/FLUORO UNIT.
8. CABLE DRAPE RAIL FOR X6190, RAD/FLUORO UNIT.
9. LOCATION AND QUANTITY OF A1130, NITROGEN CONTROL CABINET. MAY VARY.
10. THESE CHASES ARE PROVIDED FOR THE LOW RETURN AIR. SIZE AND SHAPE MAY VARY.
11. MOUNT A5145, HOOK, AT 1372 [4'-6"] AFF.
12. MOUNT A5145, HOOK, AT 1524 [5'-0"] AFF.
13. P3200, ELECTRONIC LAVATORY, MAY BE USED INSTEAD OF P3100, LAVATORY. FOR THE P3200 PROVIDE EITHER BATTERY POWER OR HARD WIRED CONNECTION.
14. 305mm [12"] W x 64mm [2 1/2"] D FLOOR TRENCH DUCT. REFER TO 3.16.05 FOR CONTINUATION.

XRAY, CARDIAC CATH EXPOSURE (XCCE1)

CARDIOLOGY/PULMONARY SERVICES

FLOOR/EQUIPMENT PLAN 54.73 NSM (589 NSF)

DATE: 01/28/2002

0 1000 2000

1:50 SCALE (MILLIMETERS)