


EAST

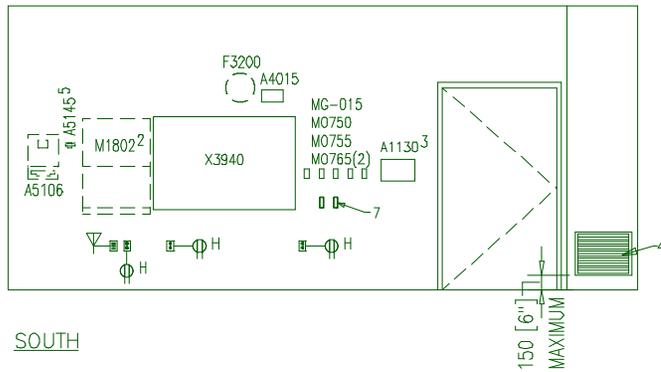

SOUTH

KEY NOTES

1. LENGTH OF E1500, WALL MOUNTED RAIL, TO BE DETERMINED BY MANUFACTURER/INSTALLER.
2. COORDINATE LOCATION OF ELECTRICAL OUTLETS WITH M1802, WALL MOUNTED, FOLD DOWN COMPUTER.
3. LOCATION AND QUANTITY OF A1130, NITROGEN CONTROL CABINET, MAY VARY.
4. LOW RETURN AIR REGISTER.
5. MOUNT A5145, HOOK, AT 1524 [5'-0"] AFF.
6. P3200, ELECTRONIC LAVATORY, MAY BE USED INSTEAD OF P3100, LAVATORY. FOR THE P3200 PROVIDE EITHER BATTERY POWER OR HARD WIRED CONNECTION.
7. VACUUM SLIDE.

General Notes:

1. For typical equipment mounting heights see "TYPICAL EQUIPMENT MOUNTING HEIGHTS" drawing.
2. MIL-STD-1691 data can only be accessed from the Equipment Plan.

XRAY, CARDIAC CATH EXPOSURE (XCCE1)

CARDIOLOGY/PULMONARY SERVICES

ELEVATIONS

DATE: 01/28/2002

54.73 NSM (589 NSF)

0 1000 2000



1:50 SCALE (MILLIMETERS)